


CSA Certified Match-Lit 19", 25", Bowl

REVISIONS

ZONE	REV	DESCRIPTION	DATE	APPROVED

Minimum 6" x 6"
Access Panel

Start-Up Shut Down Label
Needs to be Installed Near Valve
And May Fit On Inside of Panel
Door.

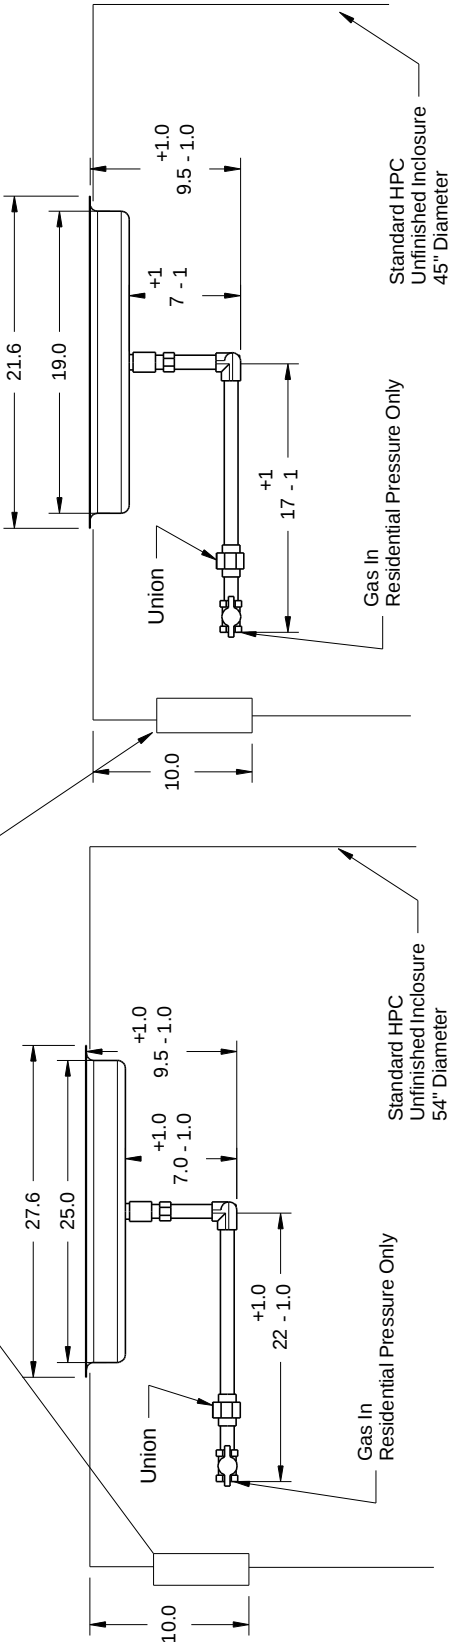

* For Use With Fixed Piping Systems Only.
* Not For Use With Small Tanks

All Enclosures Require 2 each 18 sq/in vents on opposing sides and adequate drainage.		All Dimensions Are Estimates And May Change With Out Notice		MLFPK 19, MLFPK 25	
There will be a label plate riveted to the bottom of the pan. Removal of the label will void the certification.		DRAWN		 Hearth Products Controls Co	
Read All Instructions Carefully		CHECKED		SIZE	REV
Modification of Product Will Void the Certification		QA		FSCM NO.	DWG NO.
		MFG		SCALE	SHEET
		APPROVED			
		DATE			